


# Overview of 4kV Construction in Manhattan Beach for El Porto Sub Removal

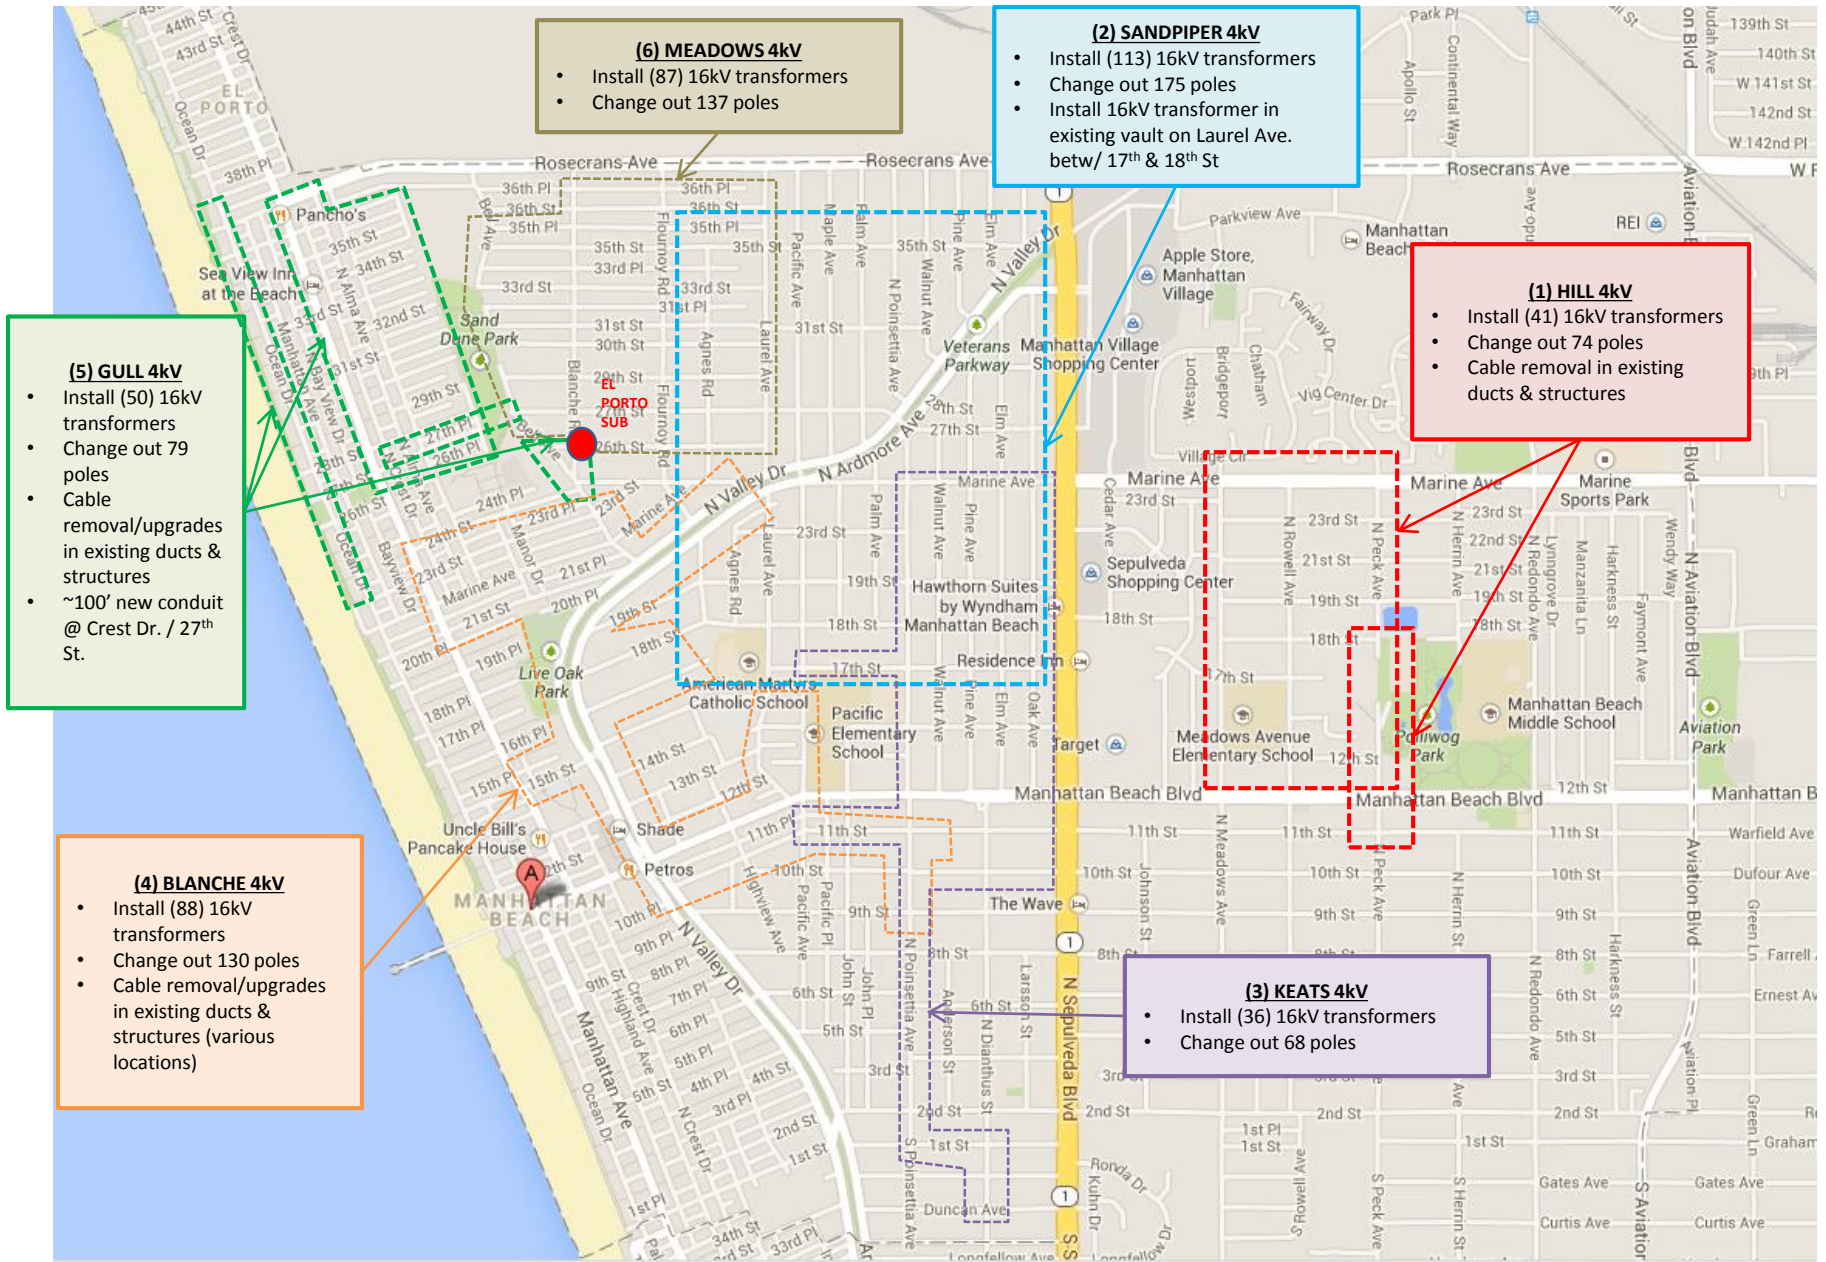

**(6) MEADOWS 4kV**

- Install (87) 16kV transformers
- Change out 137 poles

**(2) SANDPIPER 4kV**

- Install (113) 16kV transformers
- Change out 175 poles
- Install 16kV transformer in existing vault on Laurel Ave. betw/ 17<sup>th</sup> & 18<sup>th</sup> St

**(1) HILL 4kV**

- Install (41) 16kV transformers
- Change out 74 poles
- Cable removal in existing ducts & structures

**(5) GULL 4kV**

- Install (50) 16kV transformers
- Change out 79 poles
- Cable removal/upgrades in existing ducts & structures
- ~100' new conduit @ Crest Dr. / 27<sup>th</sup> St.

**(4) BLANCHE 4kV**

- Install (88) 16kV transformers
- Change out 130 poles
- Cable removal/upgrades in existing ducts & structures (various locations)

**(3) KEATS 4kV**

- Install (36) 16kV transformers
- Change out 68 poles